



# TEST REPORT

## FL76 Composite Cover BS EN124 Class F900 Load Bearing Test

Document reference number - FIB-FL76-F900-16-08-19

**Report by:**

M.A.Salisbury  
Senior Technician

M. A. Salisbury 

**Date test carried out:**

16<sup>th</sup> August 2019

**Customer name:**

Fibrelite Composites Ltd.  
Snaygill Industrial Estate,  
Keighley Road,  
Skipton,  
North Yorkshire  
BD23 2QR

## Clarifying Statements:

1. The results reported have been performed in accordance with the test requirements agreed by the customer (Fibrelite Ltd.) and laid down in the new BS EN 124-1: 2015 standard along with the composite section EN 124-5.
2. This report does not include or imply any expert opinions as to the serviceability of the sample tested or their suitability for a specific purpose.
3. The submitter disclaims any liability of any kind for any damage whatsoever resulting from the use of either data in the files or the attached values of the test results reported.
4. The report may not be reproduced other than in full, except with the prior written consent of the Engineering Dept., Lancaster University.
5. All testing has been carried out in within the Engineering Department, Gillow Ave., Lancaster University, Bailrigg, Lancaster LA1 4YW.
6. This report applies only to those items and/or materials that have been tested and reported on herein. No inference shall be made to similar test items or materials/ samples.

## **Cover**

The composite cover supplied is a square FL76 F900 complete with aluminium frame.  
(Photo.1)

## **Test Rig**

The test rig consists of a 'giant mecanno' frame bolted to the floor and supporting an Enerpac 100 ton hydraulic cylinder. (Photo.1)

The cover was seated on steel channels with steel plates and shims to pack and level.

A steel box section frame was placed around the aluminium frame to support and for safety.

In accordance with the EN124-1:2015 standard the load cell and test rig complies with EN ISO 7500-1:2004 minimum Class 3.

Test Rig ID: EG100TF

Load Cell ID: 3243N

Instron Calibration Certificate No. E187111418130655

System Class: 2



Calibration cert.

Photo.1

Photograph 2 below shows the calibration certificate for the load cell and test rig.

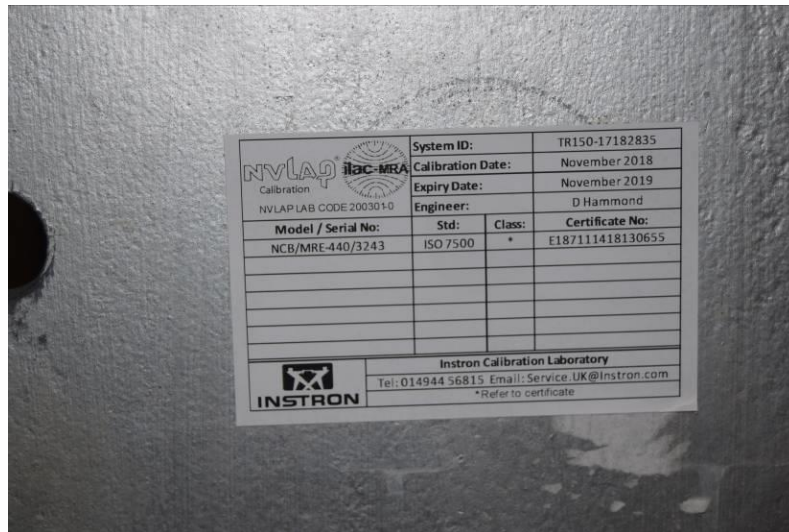


Photo.2

## **Test**

**The tests were carried out in accordance with the BS EN124:2015 standard for:**

- Permanent Set – Clause 8.2
- Load Bearing Capacity – Clause 8.3

The load was applied to the cover through a 250mm diameter by 45mm thick steel block with a 250mm diameter by 10mm rubber pad between the block and cover.

### **Permanent Set Test**

Measurement of permanent set shall be made on the upper-side of the cover in the same place as the applied load at the longest dimension which can be inscribed within the cover through the centre point of the load application. The measurement device shall be positioned as close as possible to the centre point of the load application and the seating of the measuring device support as close as possible to the edge of the cover but not exceeding 10mm from the edge.

An initial reading is to be taken at the geometric centre of the cover before the first load or any preloading has taken place.

The load is then to be applied at a rate of 1kN/s to 5kN/s up to 2/3 of the test load. This procedure is to be carried out five times without significant disruption.

A final deflection reading shall then be taken and the permanent set determined as the difference of the measured readings between the first and fifth readings.

### **Load Bearing Capacity**

Immediately after the permanent set test the cover shall be loaded up to the test load at a rate of 1kN/s to 5kN/s.

The test load shall then be maintained for  $30\frac{+2}{-0}$  seconds.

## Results

### Permanent set test



Photo.4

Initial Reading	0.00mm
Reading after 5 cycles	0.28mm
<b>Permanent Set</b>	<b>0.28mm</b>

Permissible permanent set for a F900 test is  $\frac{CO}{300} = 760/300 = 2.53\text{mm}$

**Therefore cover passes the permanent set test.**

## Load Bearing Capacity Test

Load applied immediately after the permanent set test.

Although the standard does not require it for the load bearing test, a measuring device (linear potentiometer) was placed on the underside of the panel directly under the loading point and deflection readings taken every 600kN for the five cycles and 50kN intervals after that.

LOAD (kN)	DEFLECTION (mm)	REMARKS
0	0.00	
600	15.53	
0	2.15	
600	15.76	
0	2.37	
600	16.08	
0	2.60	
600	16.18	
0	2.75	
600	16.13	
0	2.67	
50	4.53	
100	6.17	
150	7.50	
200	8.62	
250	9.73	
300	10.70	
350	11.74	
400	12.71	
450	13.68	
500	14.57	
550	15.58	
600	16.57	
650	17.69	
700	18.95	
750	20.29	
800	22.13	
850	23.78	
900	25.27	
900 (10 seconds)	25.72	
900 (20 seconds)	25.87	
900 (30 seconds)	26.09	<b>PASS</b>

**The cover held the test load of 900kN for the required 30 seconds with no visible signs of failure so therefore passed the BS EN 124 F900 Load Bearing test.**

The slight difference noted between the true permanent set reading taken on the top face and that of the zero readings taken on the underside, can be explained by the cover and frame settling onto the supports.

