



# TEST REPORT

## FL96 Composite Cover BS EN124 E600 Load Bearing Test

Document reference number - FIB-FL96-E600-26-06-18

**Report by:**

M.A.Salisbury  
Senior Technician

M. A. Salisbury 

**Date test carried out:**

26<sup>th</sup> June 2018

**Customer name:**

Fibrelite Composites Ltd.  
Snaygill Industrial Estate,  
Keighley Road,  
Skipton,  
North Yorkshire  
BD23 2QR

## Clarifying Statements:

1. The results reported have been performed in accordance with the test requirements agreed by the customer (Fibrelite Ltd.) and laid down in the new BS EN 124-1: 2015 standard along with the composite section EN 124-5.
2. This report does not include or imply any expert opinions as to the serviceability of the sample tested or their suitability for a specific purpose.
3. The submitter disclaims any liability of any kind for any damage whatsoever resulting from the use of either data in the files or the attached values of the test results reported.
4. The report may not be reproduced other than in full, except with the prior written consent of the Engineering Dept., Lancaster University.
5. All testing has been carried out in within the Engineering Department, Gillow Ave., Lancaster University, Bailrigg, Lancaster LA1 4YW.
6. This report applies only to those items and/or materials that have been tested and reported on herein. No inference shall be made to similar test items or materials/ samples.

## **Cover**

The composite cover supplied is a rectangular FL96 complete with aluminium frame. (Photo.1)

**Cover No. : 188360**



Photo. 1

## **Test Rig**

The test rig consists of a 'giant mecano' frame bolted to the floor and supporting twin Enerpac 60 ton hydraulic cylinders. (Photo.2)

The cover was seated on steel channels with steel plates and shims to pack and level.

In accordance with the EN124-1:2015 standard the load cell and test rig complies with EN ISO 7500-1:2004 minimum Class 3.

Test Rig ID: EG100TF

Load Cell ID:

Instron Calibration Certificate No. E225112816155035

System Class: 2



Calibration cert.

Photo.2



## **Test**

The tests were carried out in accordance with the EN 124:2015 standard for:

- Permanent Set – Clause 8.2
- Load Bearing Capacity – Clause 8.3

The load was applied to the cover through a 250mm diameter by 45mm thick steel block with a 250mm diameter by 10mm rubber pad between the block and cover.

### **Permanent Set Test**

Measurement of permanent set shall be made on the upper-side of the cover in the same place as the applied load at the longest dimension which can be inscribed within the cover through the centre point of the load application. The measurement device shall be positioned as close as possible to the centre point of the load application and the seating of the measuring device support as close as possible to the edge of the cover but not exceeding 10mm from the edge.

An initial reading is to be taken at the geometric centre of the cover before the first load or any preloading has taken place.

The load is then to be applied at a rate of 1kN/s to 5kN/s up to 2/3 of the test load. This procedure is to be carried out five times without significant disruption.

A final deflection reading shall then be taken and the permanent set determined as the difference of the measured readings between the first and fifth readings.

### **Load Bearing Capacity**

Immediately after the permanent set test the cover shall be loaded up to the test load at a rate of 1kN/s to 5kN/s.

The test load shall then be maintained for  $30^{+2}_{-0}$  seconds.

## Results

### Permanent set test

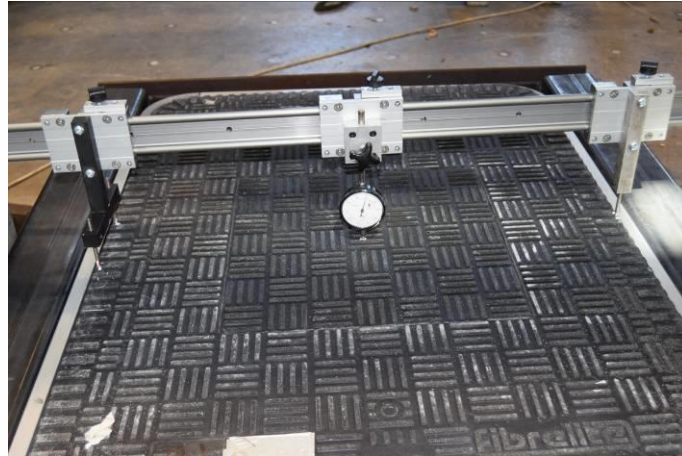


Photo.4

Initial Reading	0.00mm
Reading after 5 cycles	0.67mm
<b>Permanent Set</b>	<b>0.67mm</b>

Permissible permanent set for a E600 test is  $\frac{60}{300} = 600/300 = 2.00\text{mm}$

**Therefore cover passes the permanent set test.**

## **Load Bearing Capacity Test**

Load applied immediately after the permanent set test.

Although the standard does not require it for the load bearing test, a measuring device (linear potentiometer) was placed on the underside of the panel directly under the loading point and deflection readings taken every 600kN for the five cycles and 50kN intervals after that.

<b>LOAD (kN)</b>	<b>DEFLECTION (mm)</b>	<b>REMARKS</b>
0	0.00	
600	16.80	
0	1.50	
600	17.29	
0	1.67	
600	17.83	
0	1.76	
600	17.68	
0	1.91	
600	17.98	
0	2.00	
50	5.00	
106	6.78	
153	7.84	
200	9.06	
255	10.33	
300	11.31	
350	12.39	
412	13.79	
450	14.70	
500	15.82	
550	16.80	
600	18.13	

**The cover reached the required test load of 600kN so therefore passed the BS EN 124 E600 Load Bearing test.**

The slight difference noted between the true permanent set reading taken on the top face and that of the zero readings taken on the underside, can be explained by the central filler cap settling into the main cover.

## FL96 EN124 E600 Test

