

48" medium bury collar mount sump base, tophat, watertight platform for (2) 5-gallon spill buckets, skirt, cover frame, 40" diameter multiport cover and port covers.

For reference purposes only. This drawing is not a specification. Order against product code only. To enable continuous improvement of our products, the designs and specifications are subject to change without notice.


FIBRELITE 
PART OF OPW A DOVER COMPANY



SC-COLOR
OPTIONAL SEALABLE
FILL PORT COVERS

Note: The OPW products listed in the table below are required for installations subject to CARB approval. These items are not included with the sump kits and must be ordered separately.


Item	Description	Qty
61SALP-1020-EVR	Fill Swivel Adapter, Brass	1
61VSA-1020-EVR	Vapor Swivel Adapter, Brass	1
634TT-7085-EVR	Fill Cap, Gray	1
1711T-7085-EVR	Vapor Cap, Orange	1
H12807M	Fill Nipple, 12" Length	1
H15268M	Vapor Nipple, 10" Length	1
FSA-400-S	Face Seal Adapter	2
61JSK-44CB	Jack Screw Assembly	2
6511-RB16	Riser Pipe Adjusters, 12" to 18" Spacers	1
71SO-T	Testable Overfill Prevention Valve	1

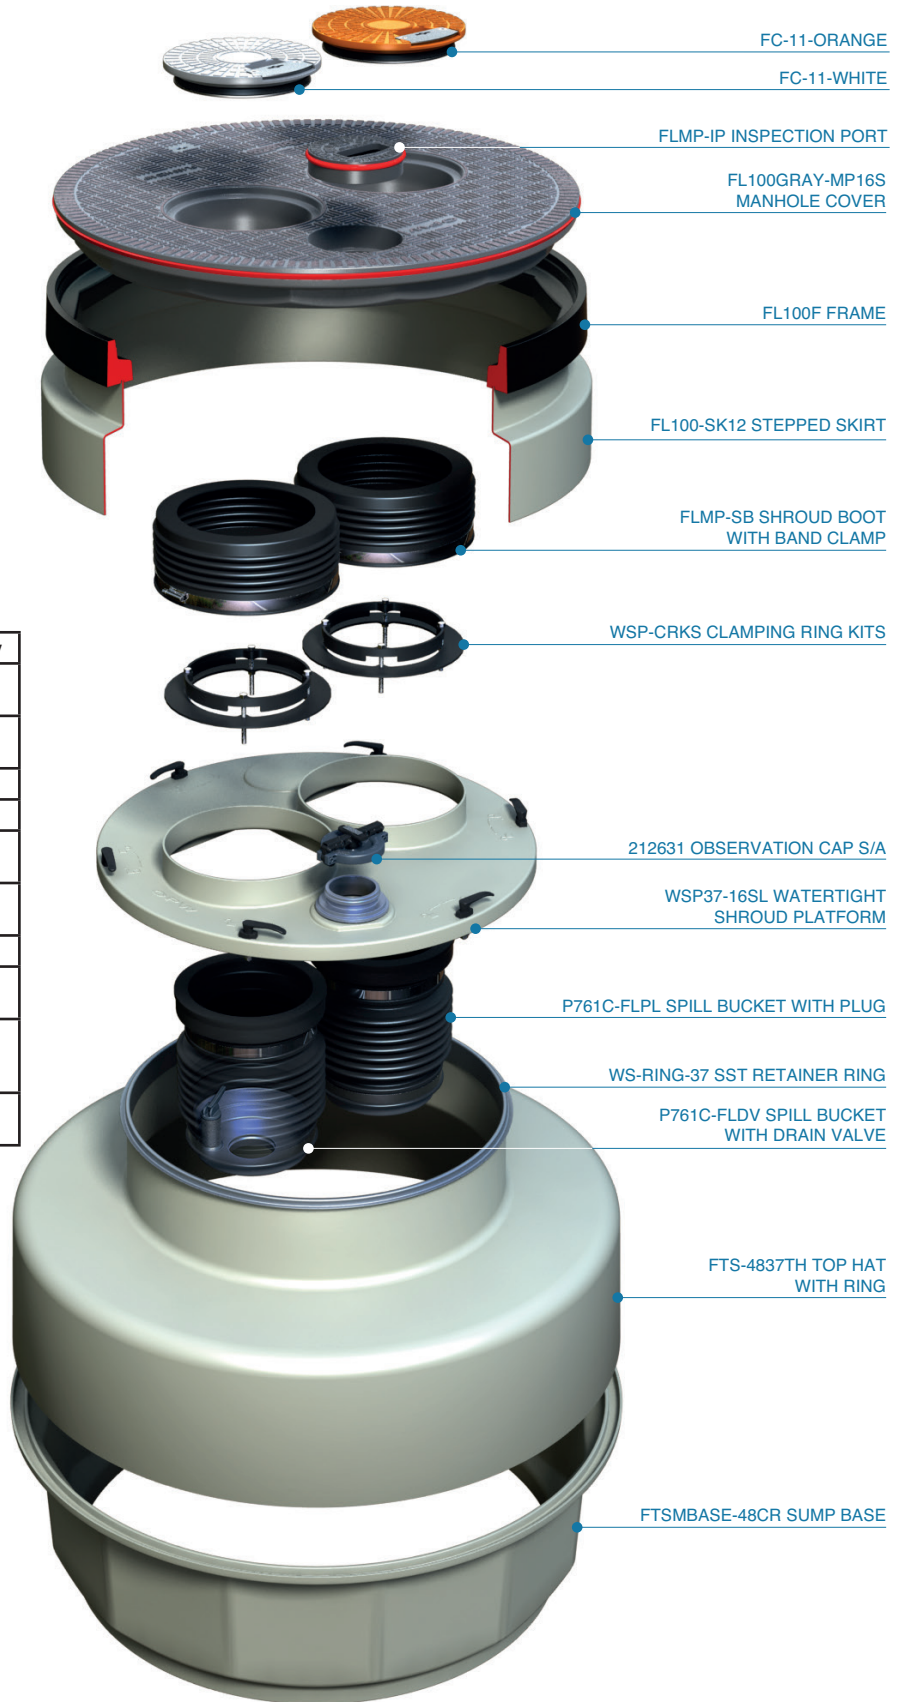

48" medium bury collar mount sump base, tophat, watertight platform for (2) 5-gallon spill buckets, skirt, cover frame, 40" diameter multiport cover and port covers.

For reference purposes only. This drawing is not a specification. Order against product code only. To enable continuous improvement of our products, the designs and specifications are subject to change without notice.

FIBRELITE 
PART OF OPW A DOWER COMPANY

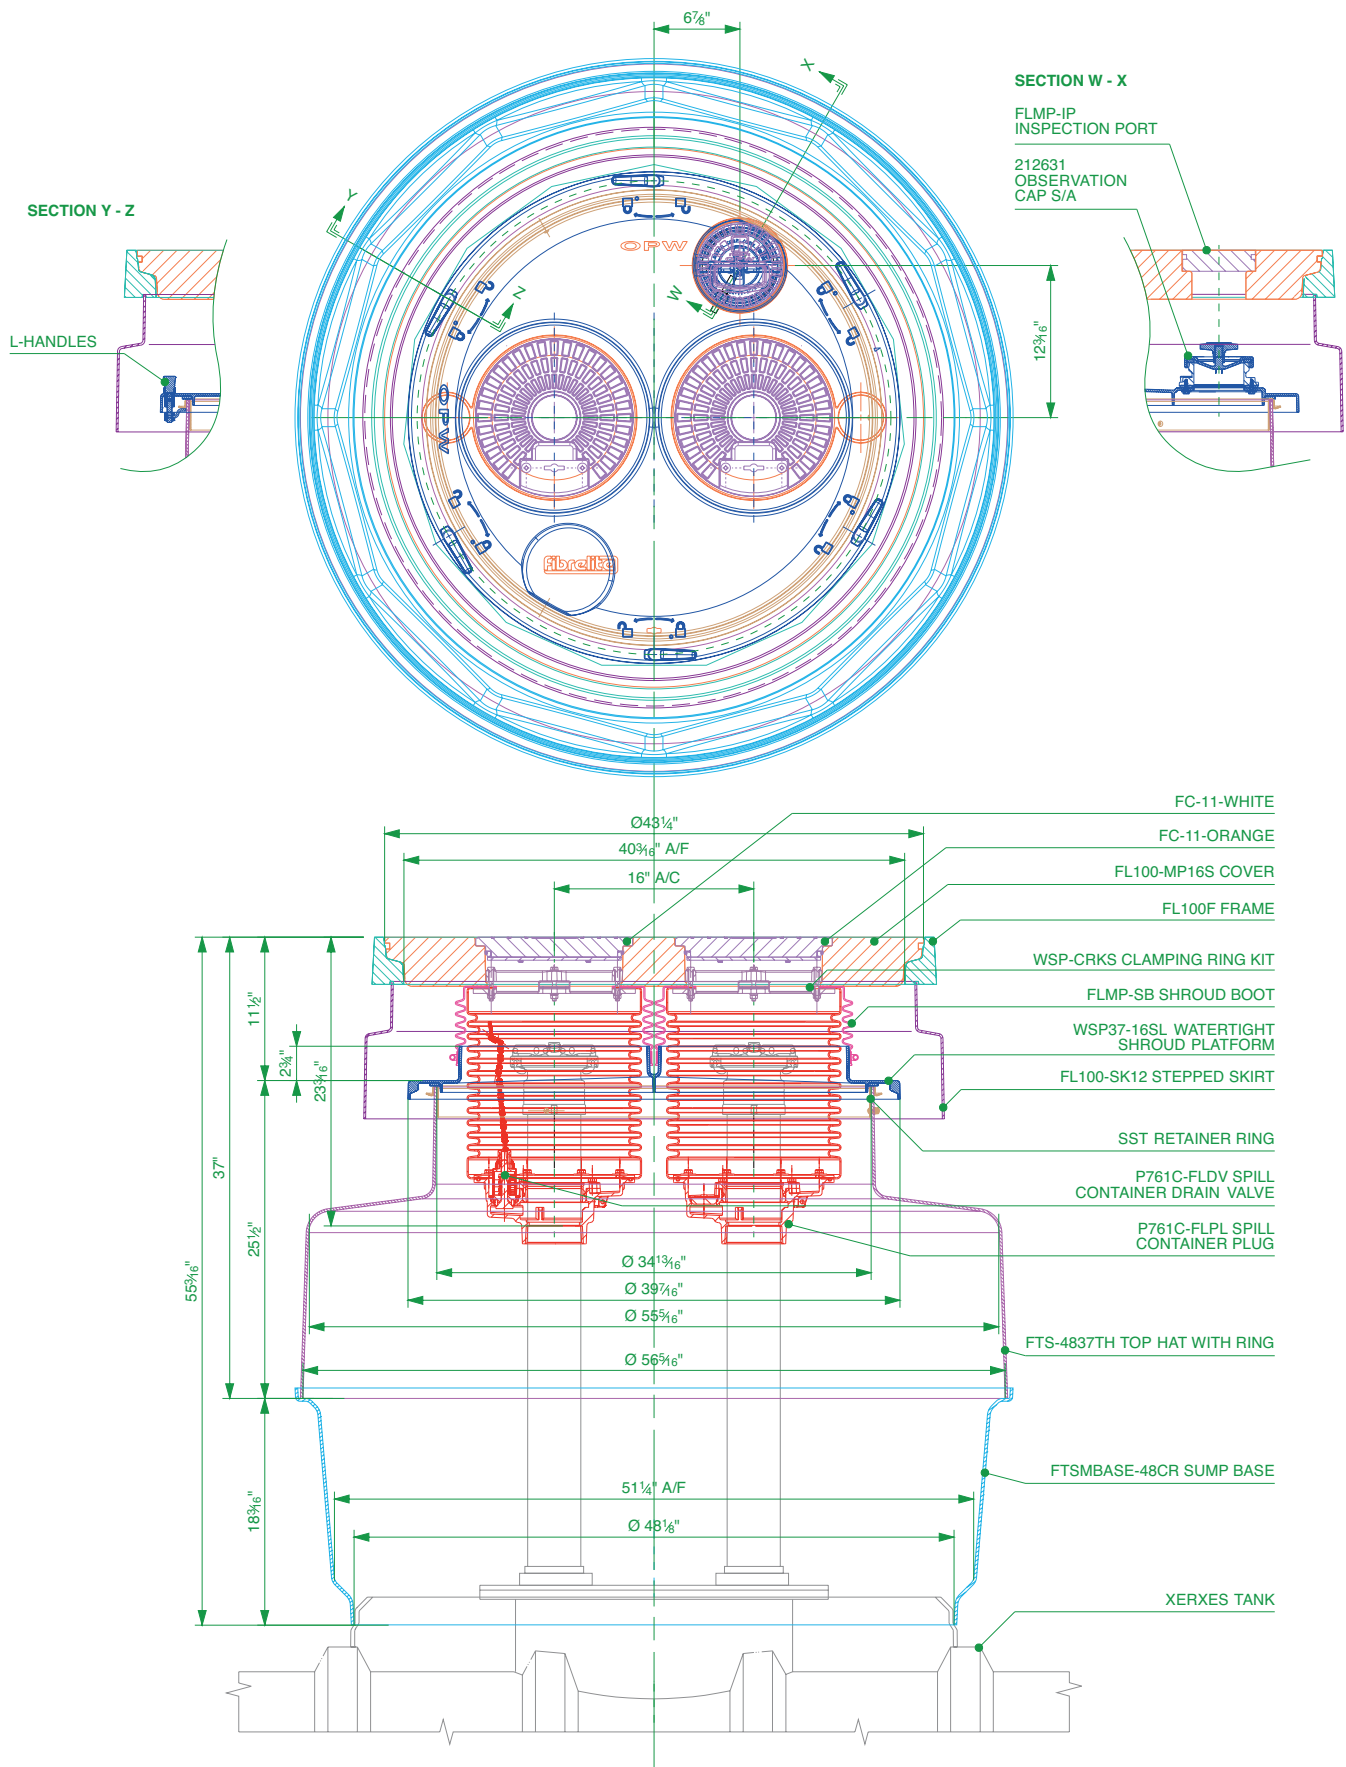

48" medium bury collar mount sump base, tophat, watertight platform for (2) 5-gallon spill buckets, skirt, cover frame, 40" diameter multiport cover and port covers.

For reference purposes only. This drawing is not a specification. Order against product code only. To enable continuous improvement of our products, the designs and specifications are subject to change without notice.

FIBRELITE

PART OF OPW A DOVER COMPANY

TYPICAL INSTALLATION

VERY IMPORTANT

To allow for drainage, Fibrelite recommends that the concrete be sloped away from the top outer edge of the frame (A) a minimum of $\frac{1}{2}$ " over a 12" distance. Do not expose the top outer edge of the frame (A) – the concrete pad must be flush with the top outer edge of the frame.


CONCRETE

VERY IMPORTANT

FRAMES MUST BE INSTALLED FLUSH WITH FINISHED GRADE OR SET SLIGHTLY BELOW FINISHED GRADE TO PROTECT FROM SNOWPLOW DAMAGE

VERY IMPORTANT

The underside of the frame must be adequately supported by concrete.

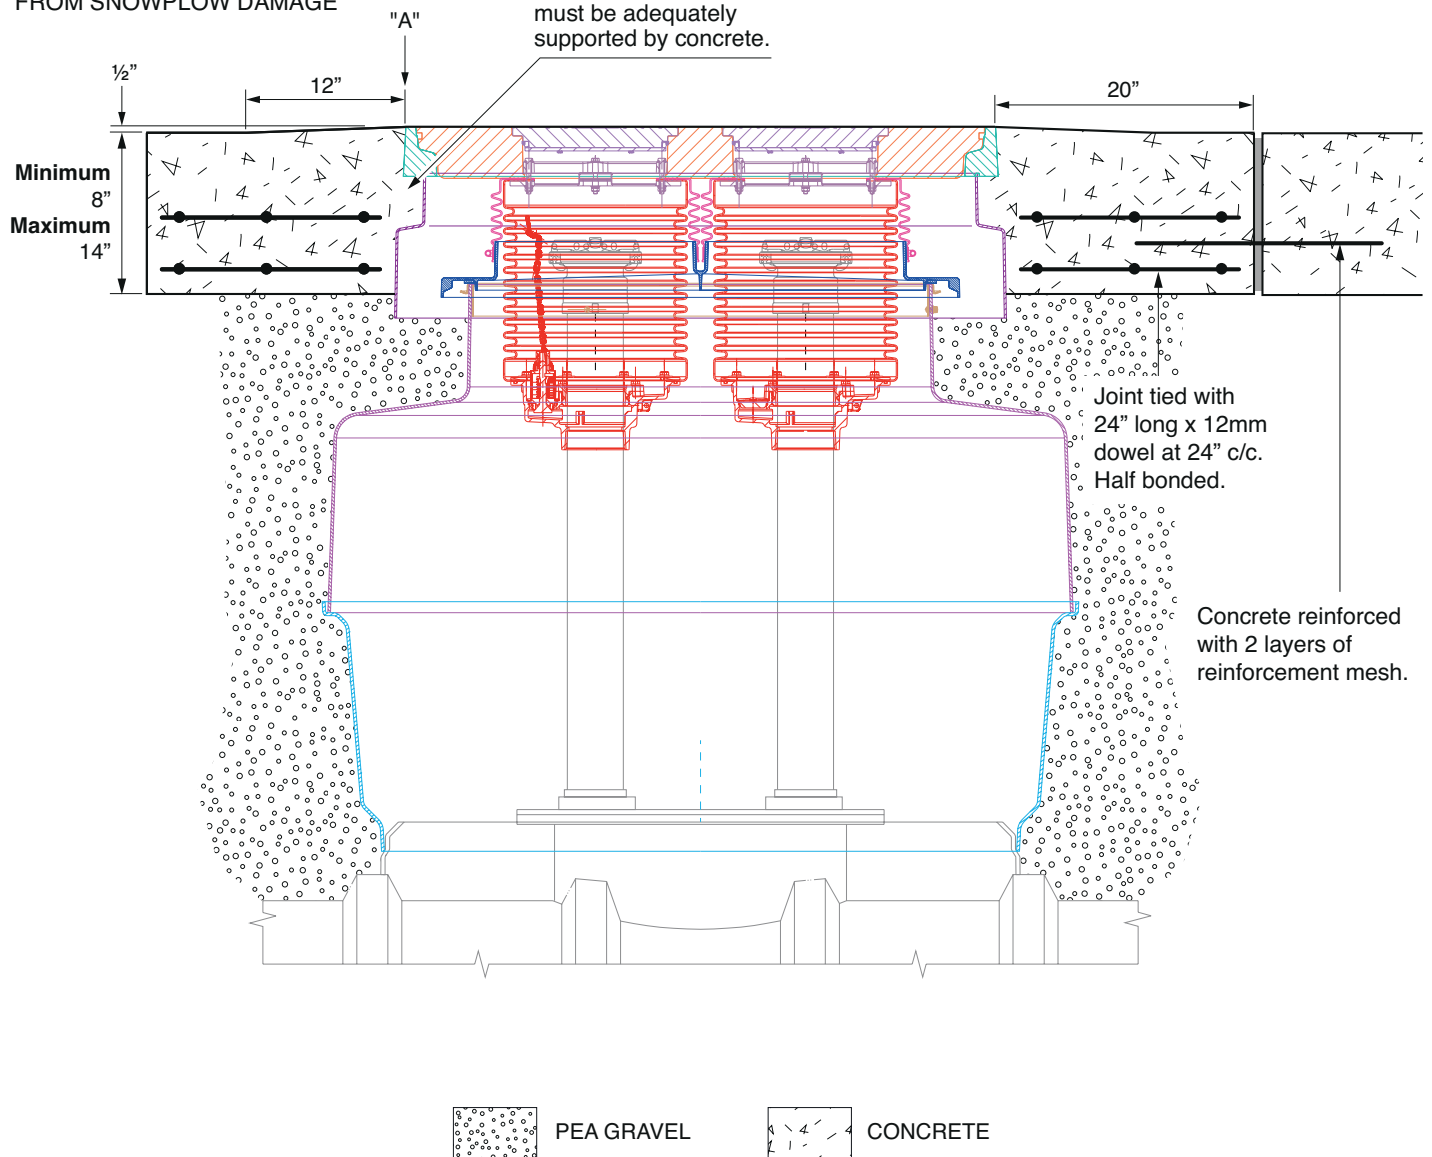

48" medium bury collar mount sump base, tophat, watertight platform for (2) 5-gallon spill buckets, skirt, cover frame, 40" diameter multiport cover and port covers.

For reference purposes only. This drawing is not a specification. Order against product code only. To enable continuous improvement of our products, the designs and specifications are subject to change without notice.

FIBRELITE

PART OF OPW A DOVER COMPANY