
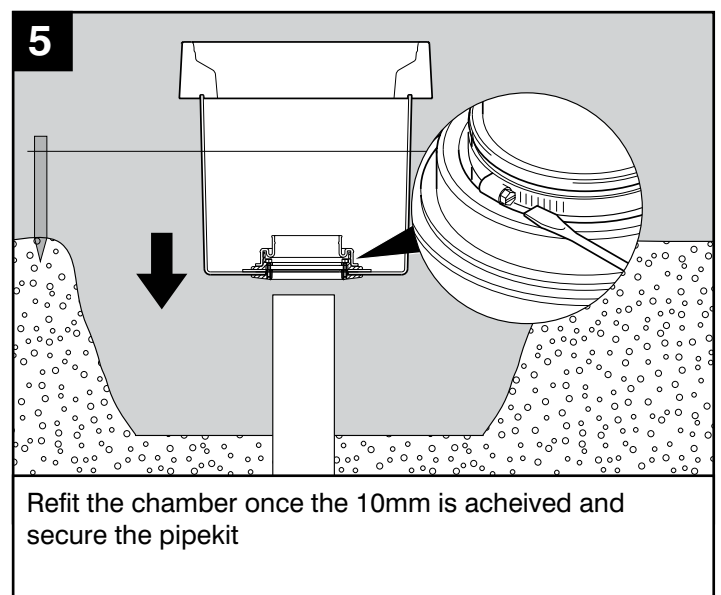
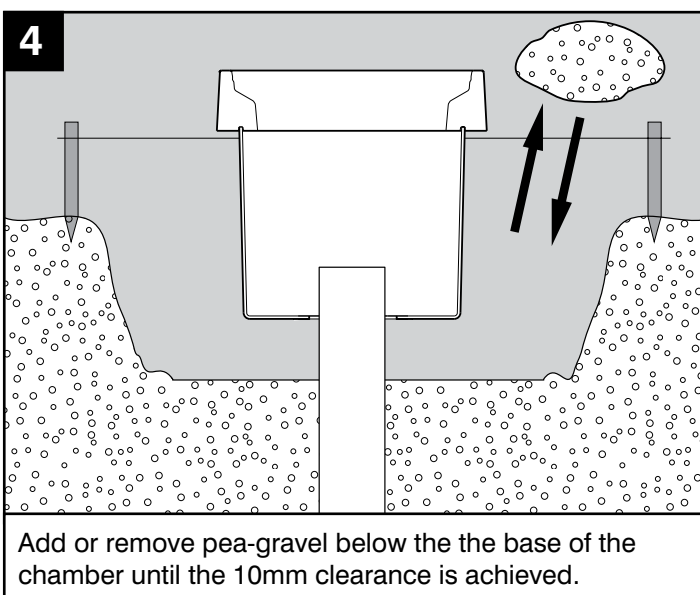
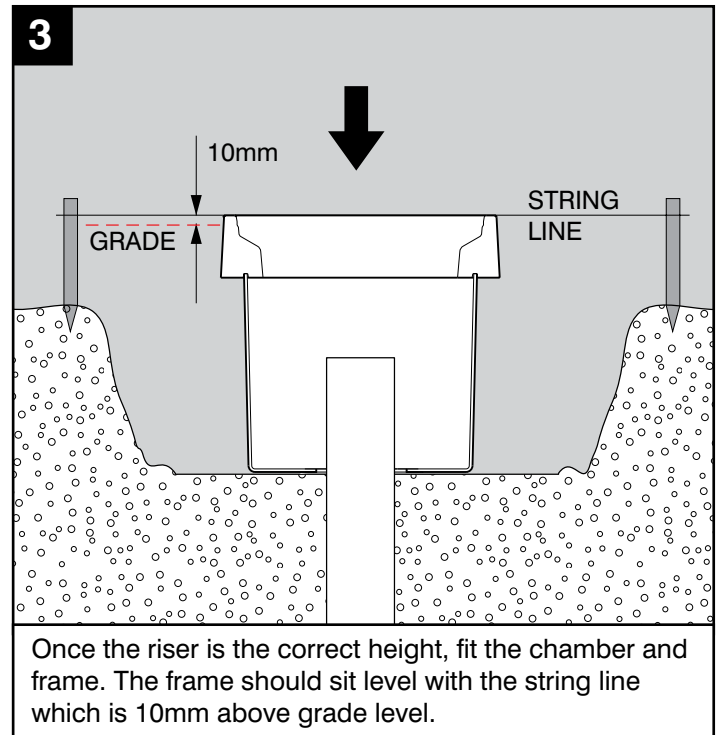
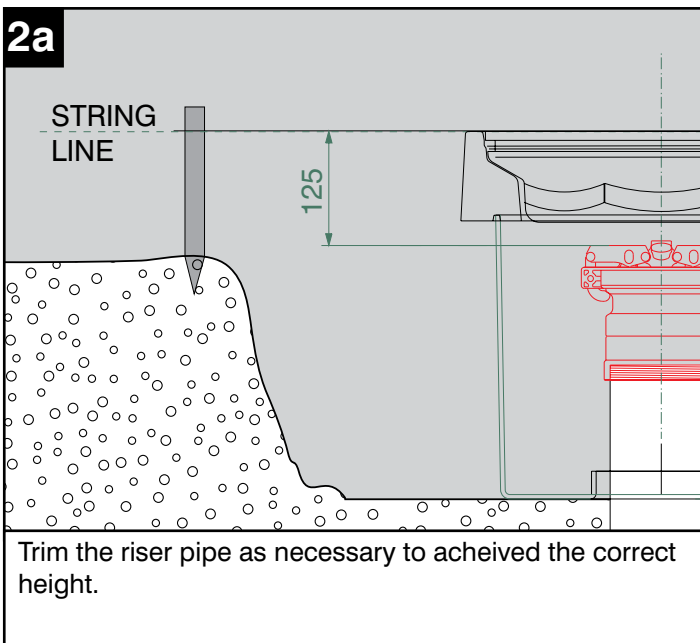
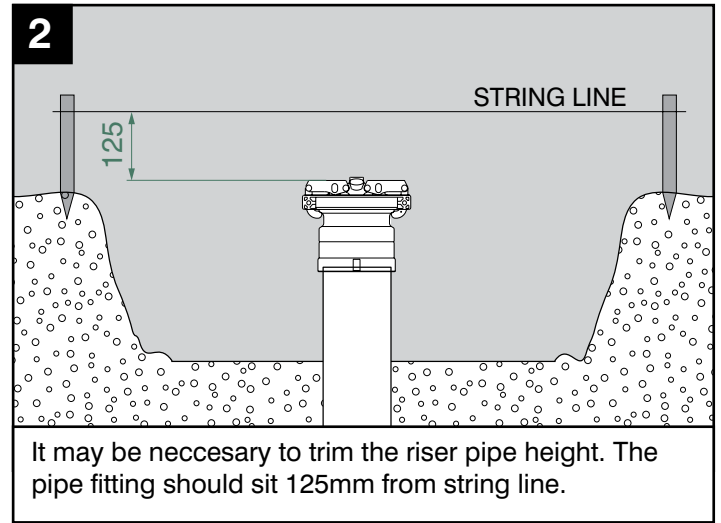



For S0-1120-MD, S0-1120-MW and S0-1120-ATG chambers systems.

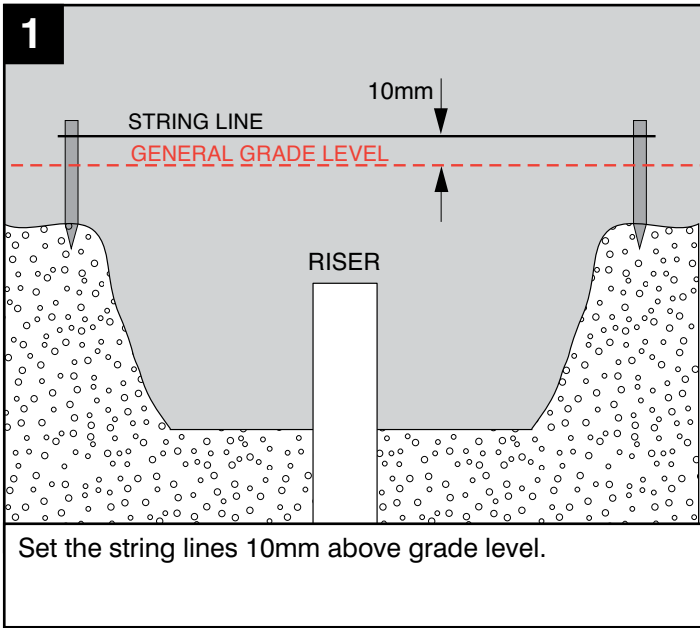

**6**


**! VERY IMPORTANT !**  
OUTER EDGE "A" OF FRAME  
SET 10MM ABOVE GENERAL  
FORECOURT AREA WITH  
CONCRETE RAMPED AWAY  
OVER 300MM

**TYPICAL INSTALLATION**

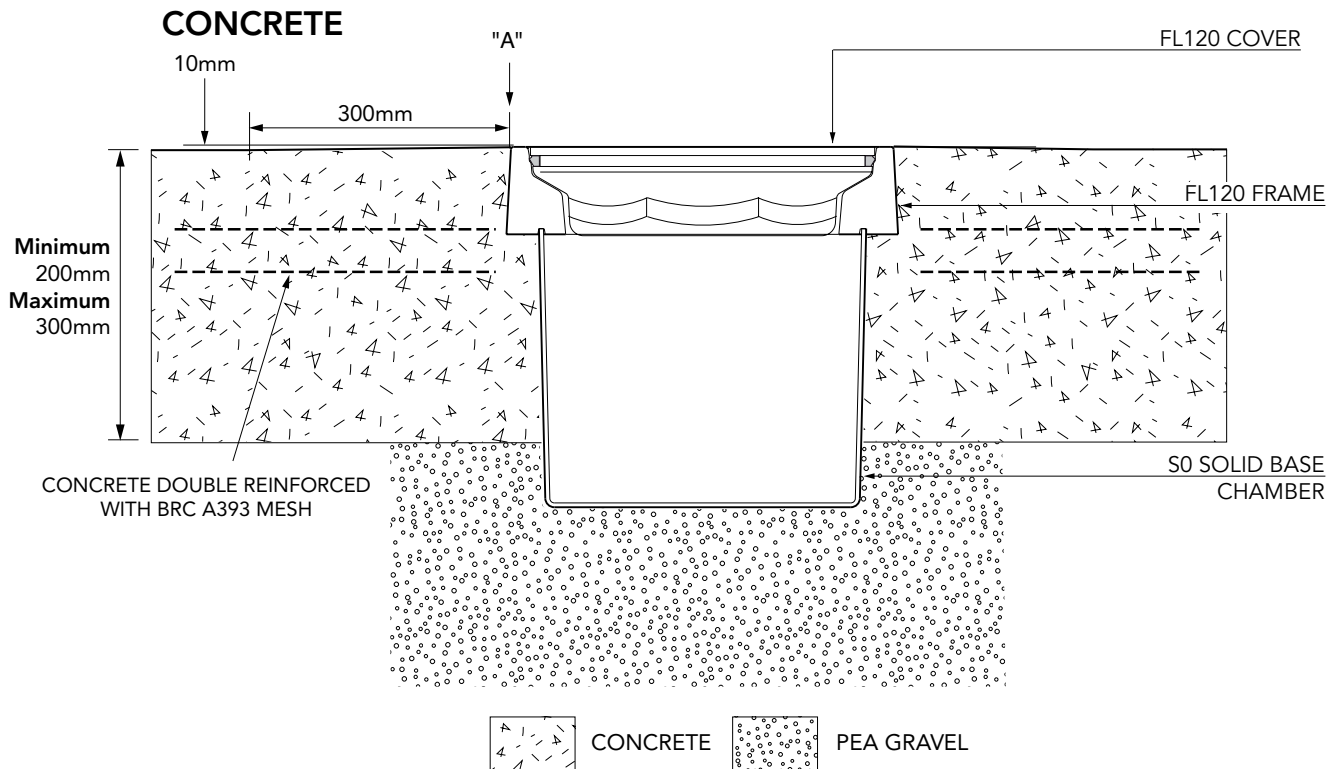


Continue to backfill and concrete. There must be minimum of 200mm and a maximum of 300mm of concrete from grade level. The concrete must be ramped approximately 10mm over 300mm from the edge of frame.

**7**

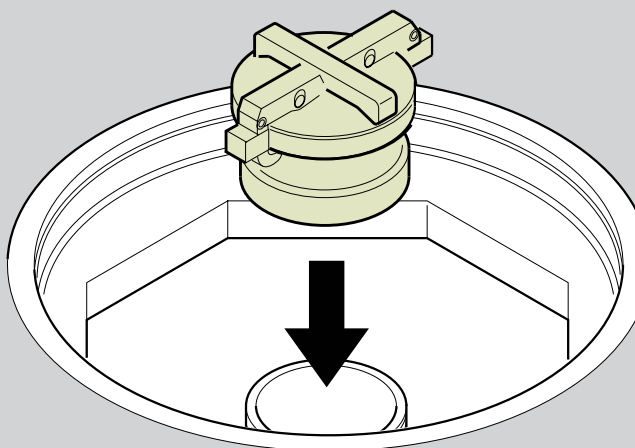

Thread on the appropriate riser fitting, MD, MW or ATG

**8**

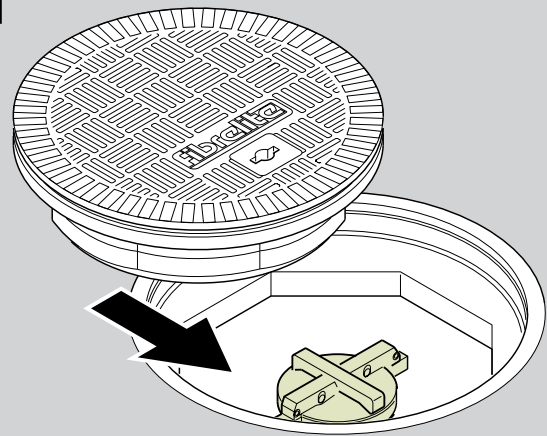

Fit the FL120 cover and stamp down to seal.